


PER 2015 I.R.C. - R8062 MINIMUM AREA: THE TOTAL NET FREE VENTILATING: AREA SHALL NOT BE LESS THAN 1/300 OF THE AREA OF THE SPACE VENTILATED, PROVIDED AT LEAST 40% AND NOT MORE THAN 50% OF THE REQUIRED VENTILATING: AREA IS PROVIDED WITH VENT OPENINGS LOCATED IN THE UPPER PORTION OF THE SPACE TO BE VENTILATED AT LEAST 3 FEET ABOVE THE EAVE OR CORNICE VENTS WITH THE BALANCE OF THE REQUIRED VENTILATION PROVIDED BY EAVE OR CORNICE VENTS, IN CLIMATE ZONE 6, T, 4 8, A CLASS I OR 2 VAPOR RETARDER SHALL BE INSTALLED ON THE WASHINGTON OF THE CLG.

(ASSUMES 25% LOSS VIA SCREEN)

TØ8.7 433 5412 T5 56

 53.3
 666.2
 46.7
 583.7
 11
 53

 50
 625.0
 50
 625.0
 66
 50

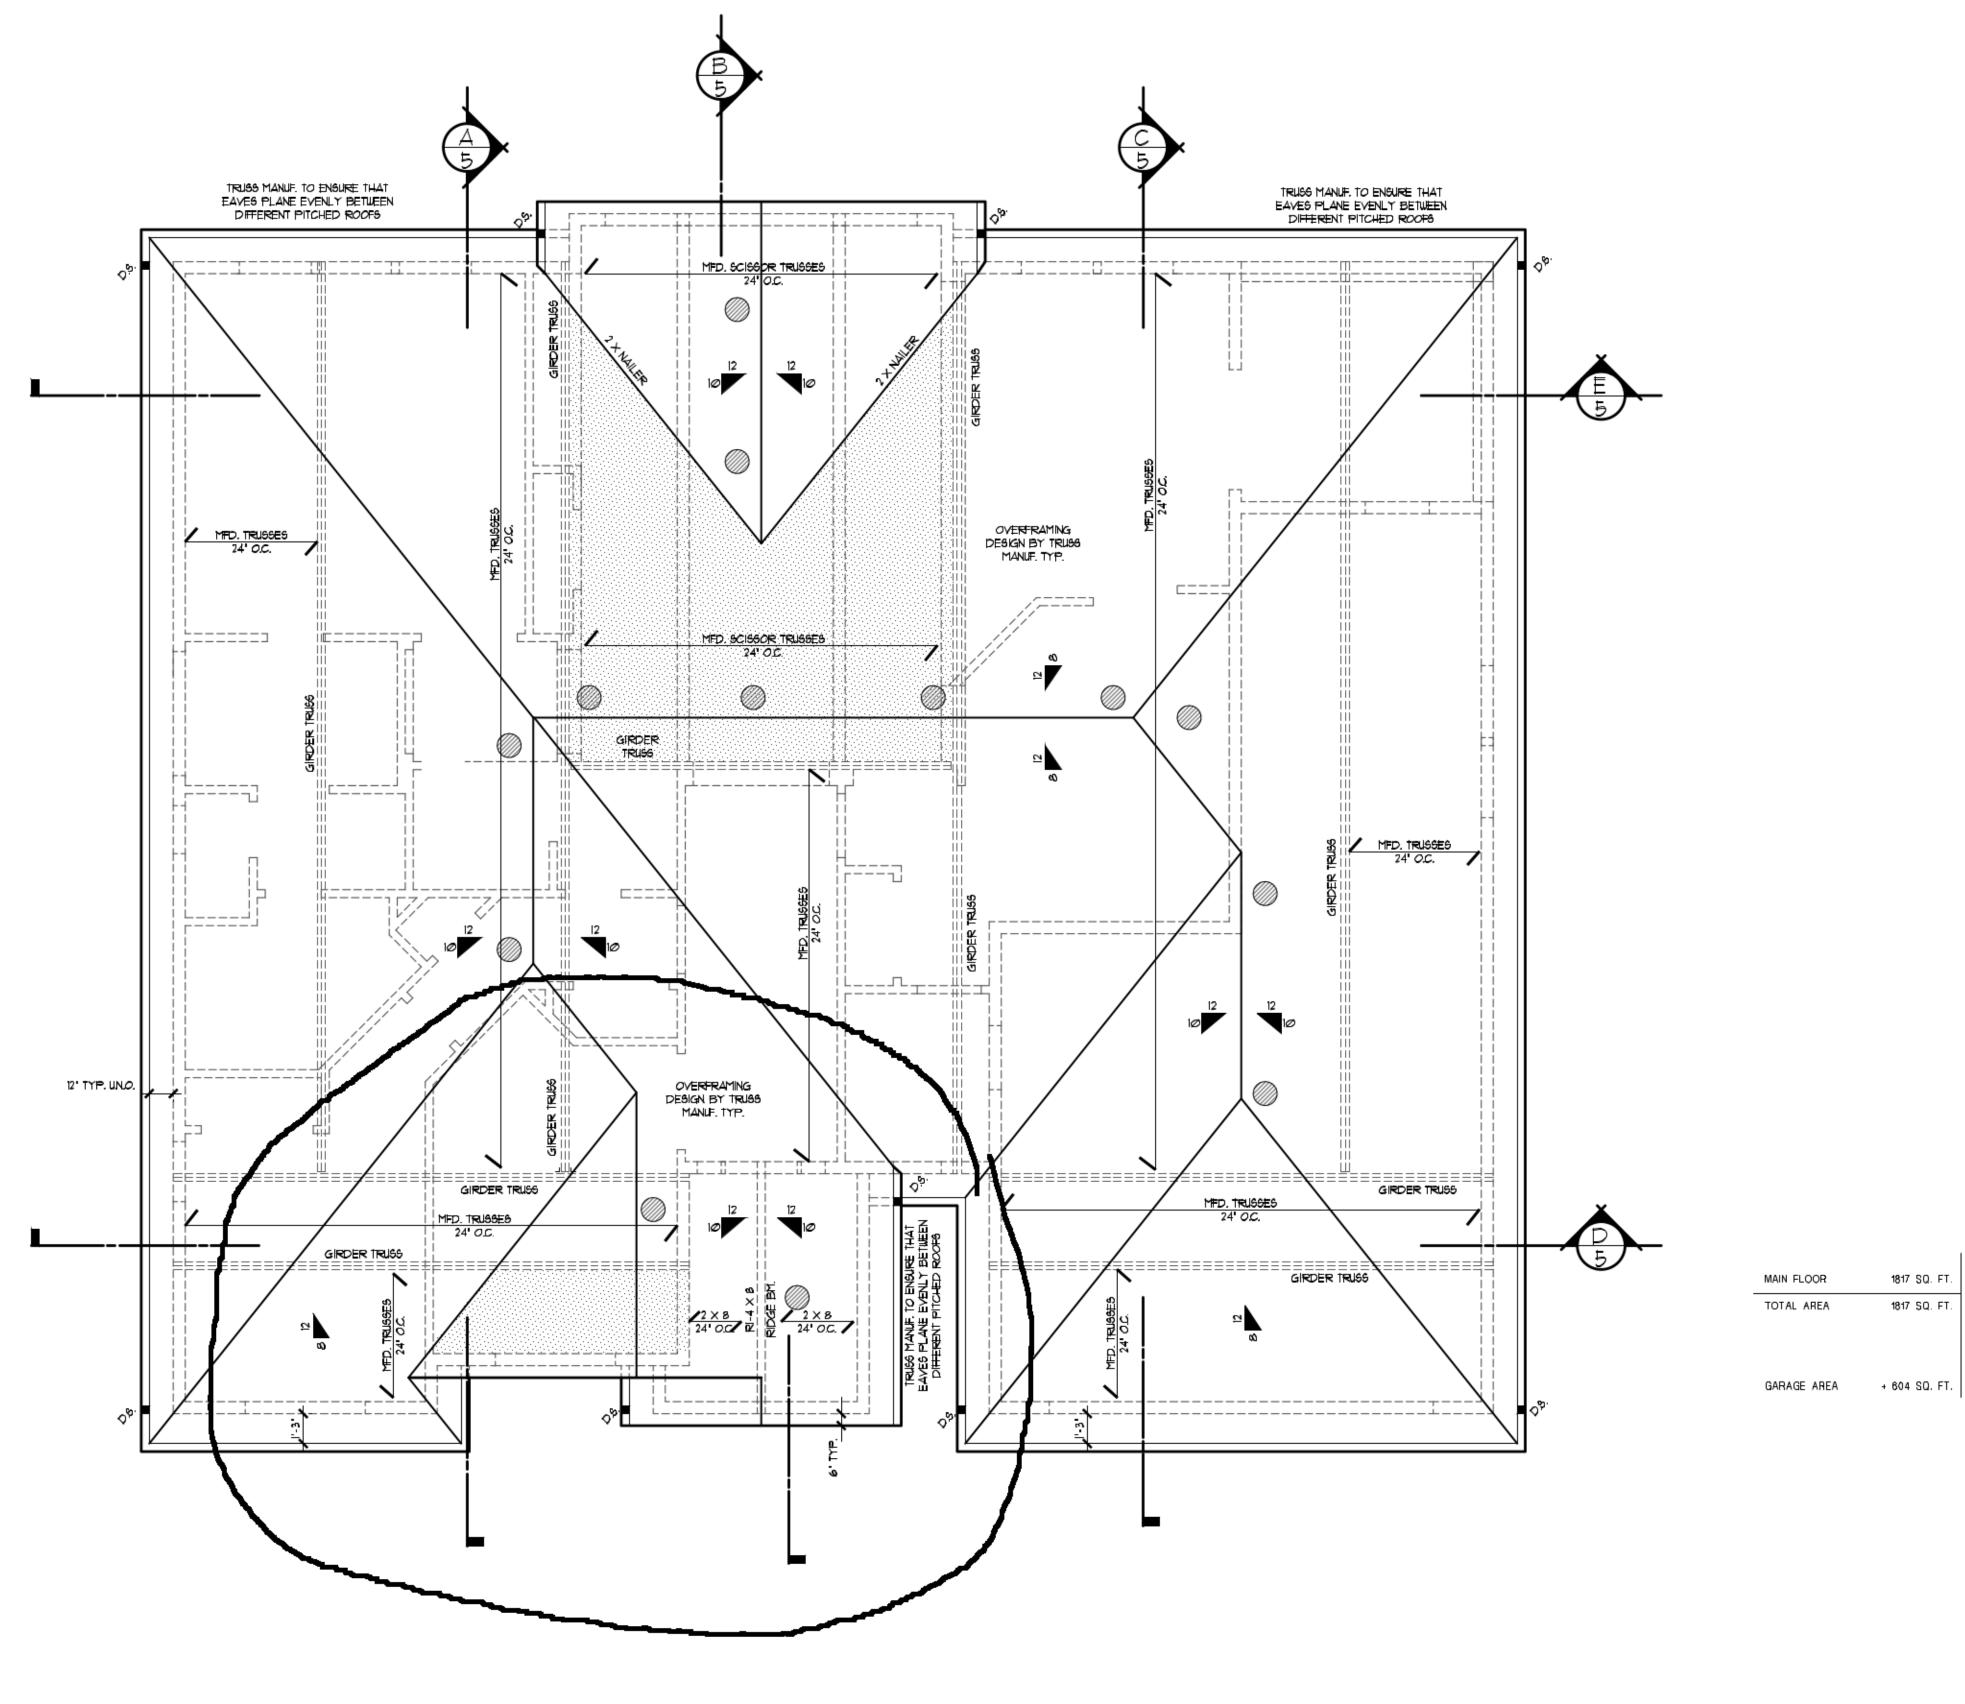

ROOF PLAN

IF LATERAL ENGINEERING IS REQUIRED, REFER TO NGINEERING SHEETS FOR LATERAL SPECIFICATIONS